


<b>Table 2</b>				
<b>Recommended Clearance Between Buildings and Outside Storage of Idle Plastic Pallets and Plastic Bins</b>				
<b>Wall Construction</b>		<b>Minimum Distance of Wall from Storage of:</b>		
		<b>Under 50 Pallets</b>	<b>50 to 200 Pallets</b>	<b>200+ Pallets</b>
<b>Wall Type</b>	<b>Openings</b>	<b>Feet</b>	<b>Feet</b>	<b>Feet</b>
Masonry	None	2	2	2
	Wired glass with outside open (AS) and 1-hour doors	10	20	50
	Wired glass or plain glass with outside open (AS)	15	40	100
Noncombustible	None			
Wood	Wood with outside open (AS)	30	80	150
Any	Plain Glass			

Notes:

- 1) Plastic pallets are treated as ordinary plastic pallets – there are some approved plastic pallets on the market that can be considered less of a fire exposure
- 2) (AS) indicates automatic sprinklers – also referred to as Exposure Sprinkler Protection – along the outside eave of a structure
- 3) Treat a mixed pile (wood and plastic) as a plastic pile – percentages are typically random

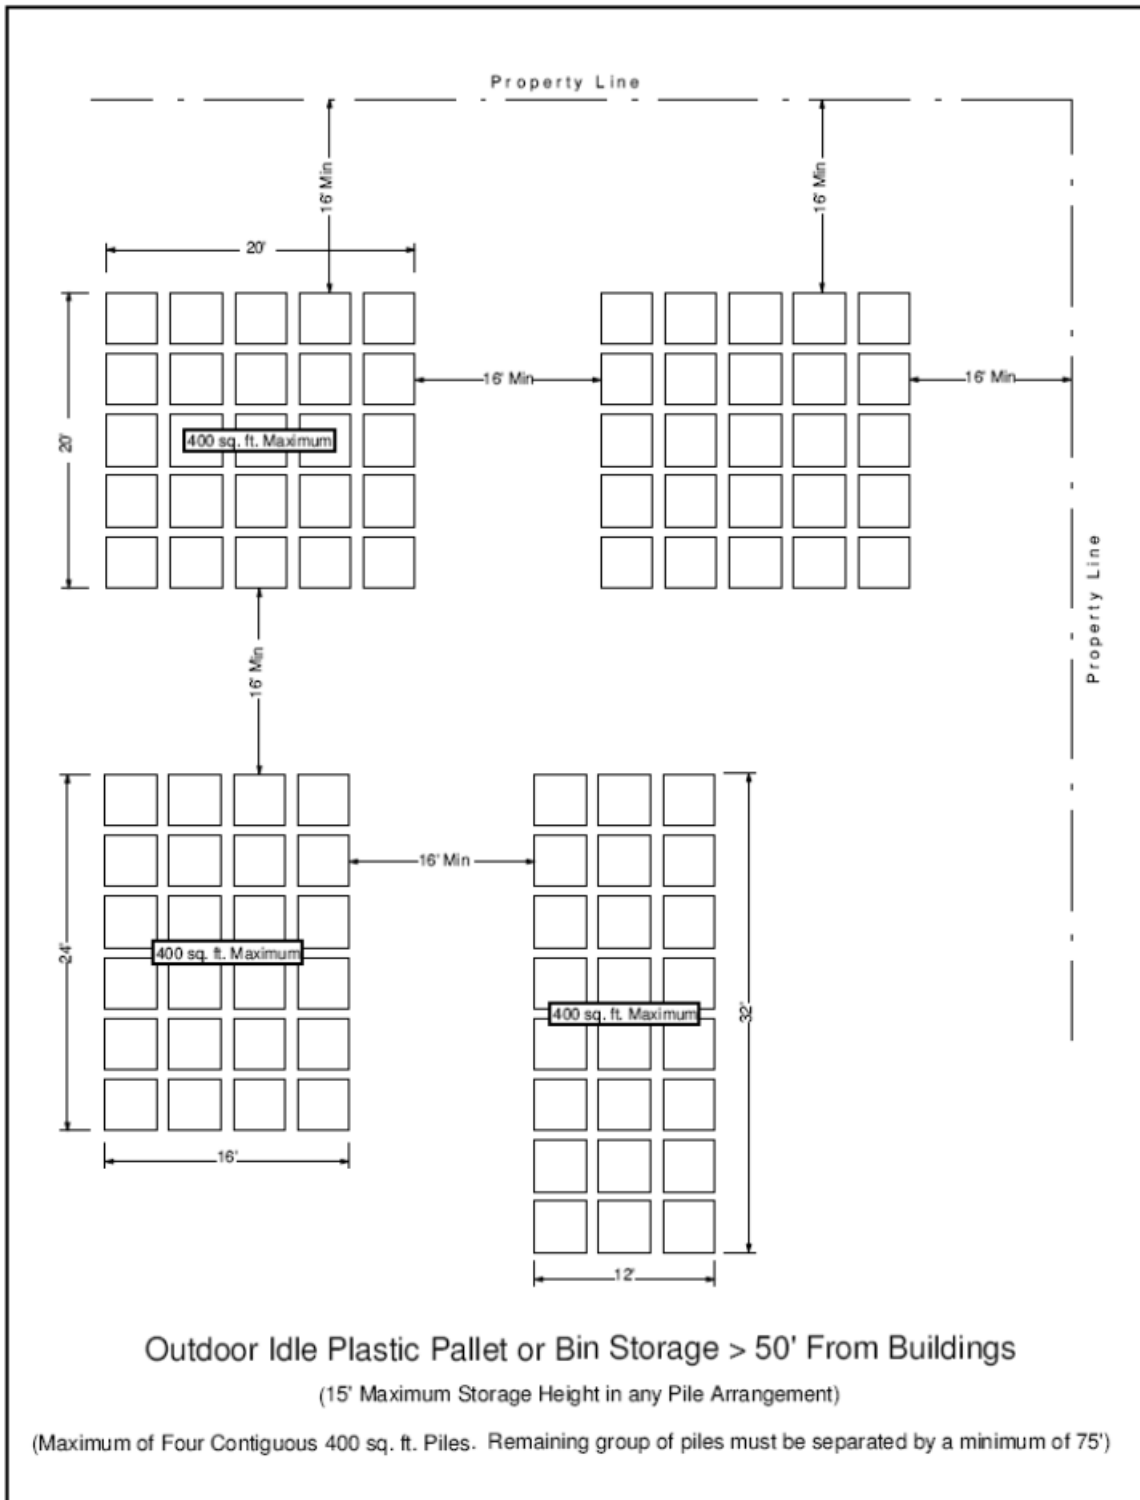

*The information included in this publication and accompanying materials was obtained from sources believed to be reliable. Nationwide Mutual Insurance Company and its employees make no guarantee of results and assume no liability in connection with any training, materials, suggestions or information provided. It is the user's responsibility to confirm compliance with any applicable local, state or federal regulations. Information obtained from or via Nationwide Mutual Insurance Company should not be used as the basis for legal advice or other advice, but should be confirmed with alternative sources. Nationwide and the Nationwide N and Eagle are service marks of Nationwide Mutual Insurance Company. © 2016 Nationwide.*